Tfn +46 (0)21 - 14 92 00
Fax +46 (0)21 - 14 92 50

KN1643FC20

HORIZONTALLY MOUNTED EMERGENCY SHOWER WITH STAY-OPEN BALL VALVE AND PULL ROD

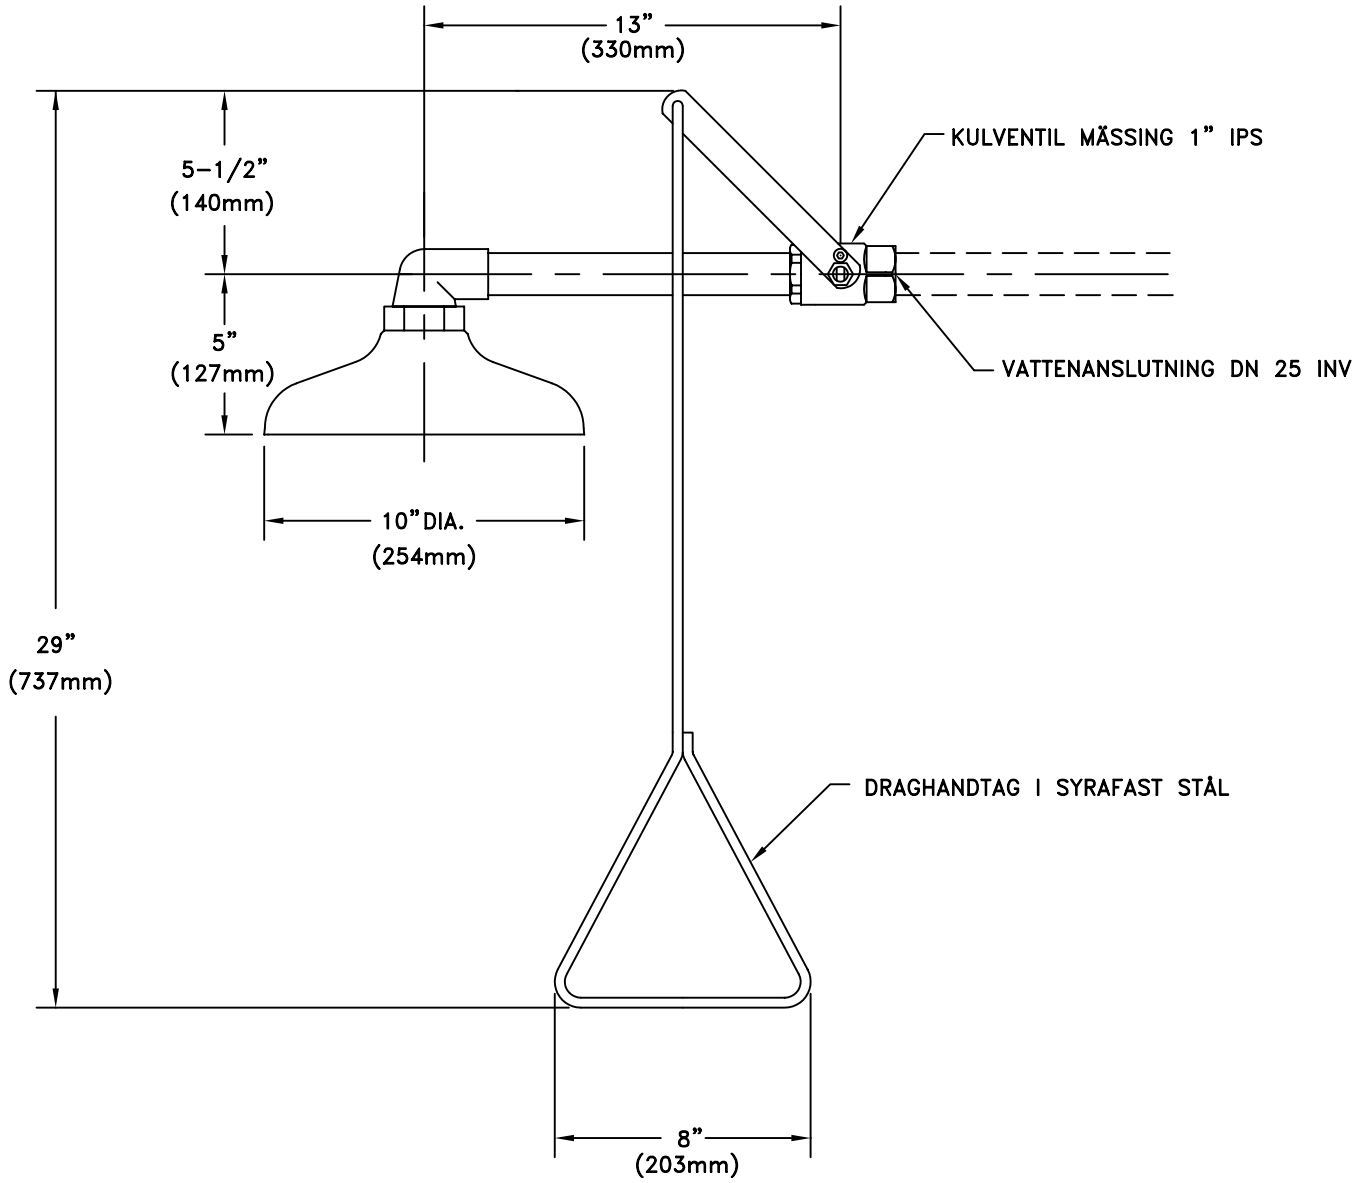

UNITS (EXCEPT THOSE WITH SELF-CLOSING VALVES) COMPLY WITH THE REQUIREMENTS OF ANSI Z358.1. TEST ALL EMERGENCY EQUIPMENT AT LEAST WEEKLY.

Drawing Number: K001-431 Approved: _____ Revision Number: 082404-TPS